



## Accessories




Thermoclick - Sealer Tape




Thermoclick - Breather Tape

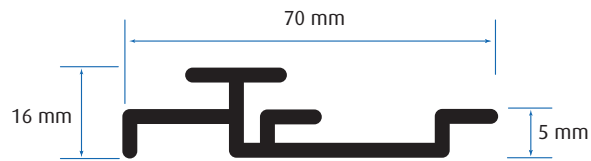

Thermoclick - Face Fix Key Bracket

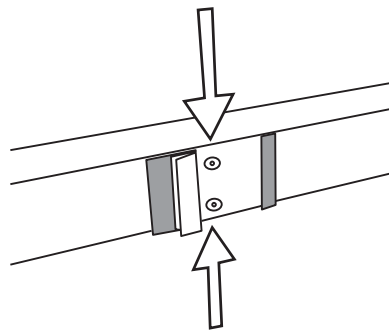

The Thermoclick fix key bracket must be fixed with at least two screws to the purlin.

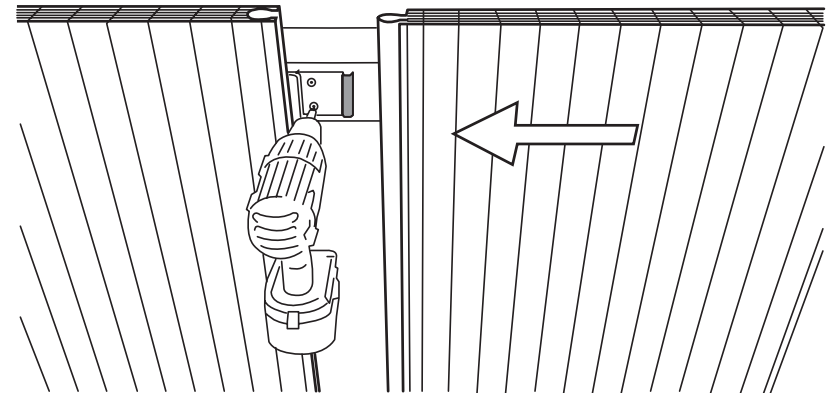

The Thermoclick fix key bracket must be positioned on the purlin and be pushed against the panel and located in the groove.